הערות

1. סוג הבטון ב-30 דרגת חשיפה (ד"ח) 3.
2. הפלדה מצולעת מסוג פ-500 (ɸ) לפי ת"י 4466 חלק 3.
3. הרשתות המרותכות (ɸ) לפי ת"י 4466 חלק 4.
4. חפיפות הרשתות 45 ס"מ לפחות. חפיפות בין ברזלים 60d לפחות.
5. עובי כיסוי בטון 3 ס"מ.

תכנית הגג
1 : 100

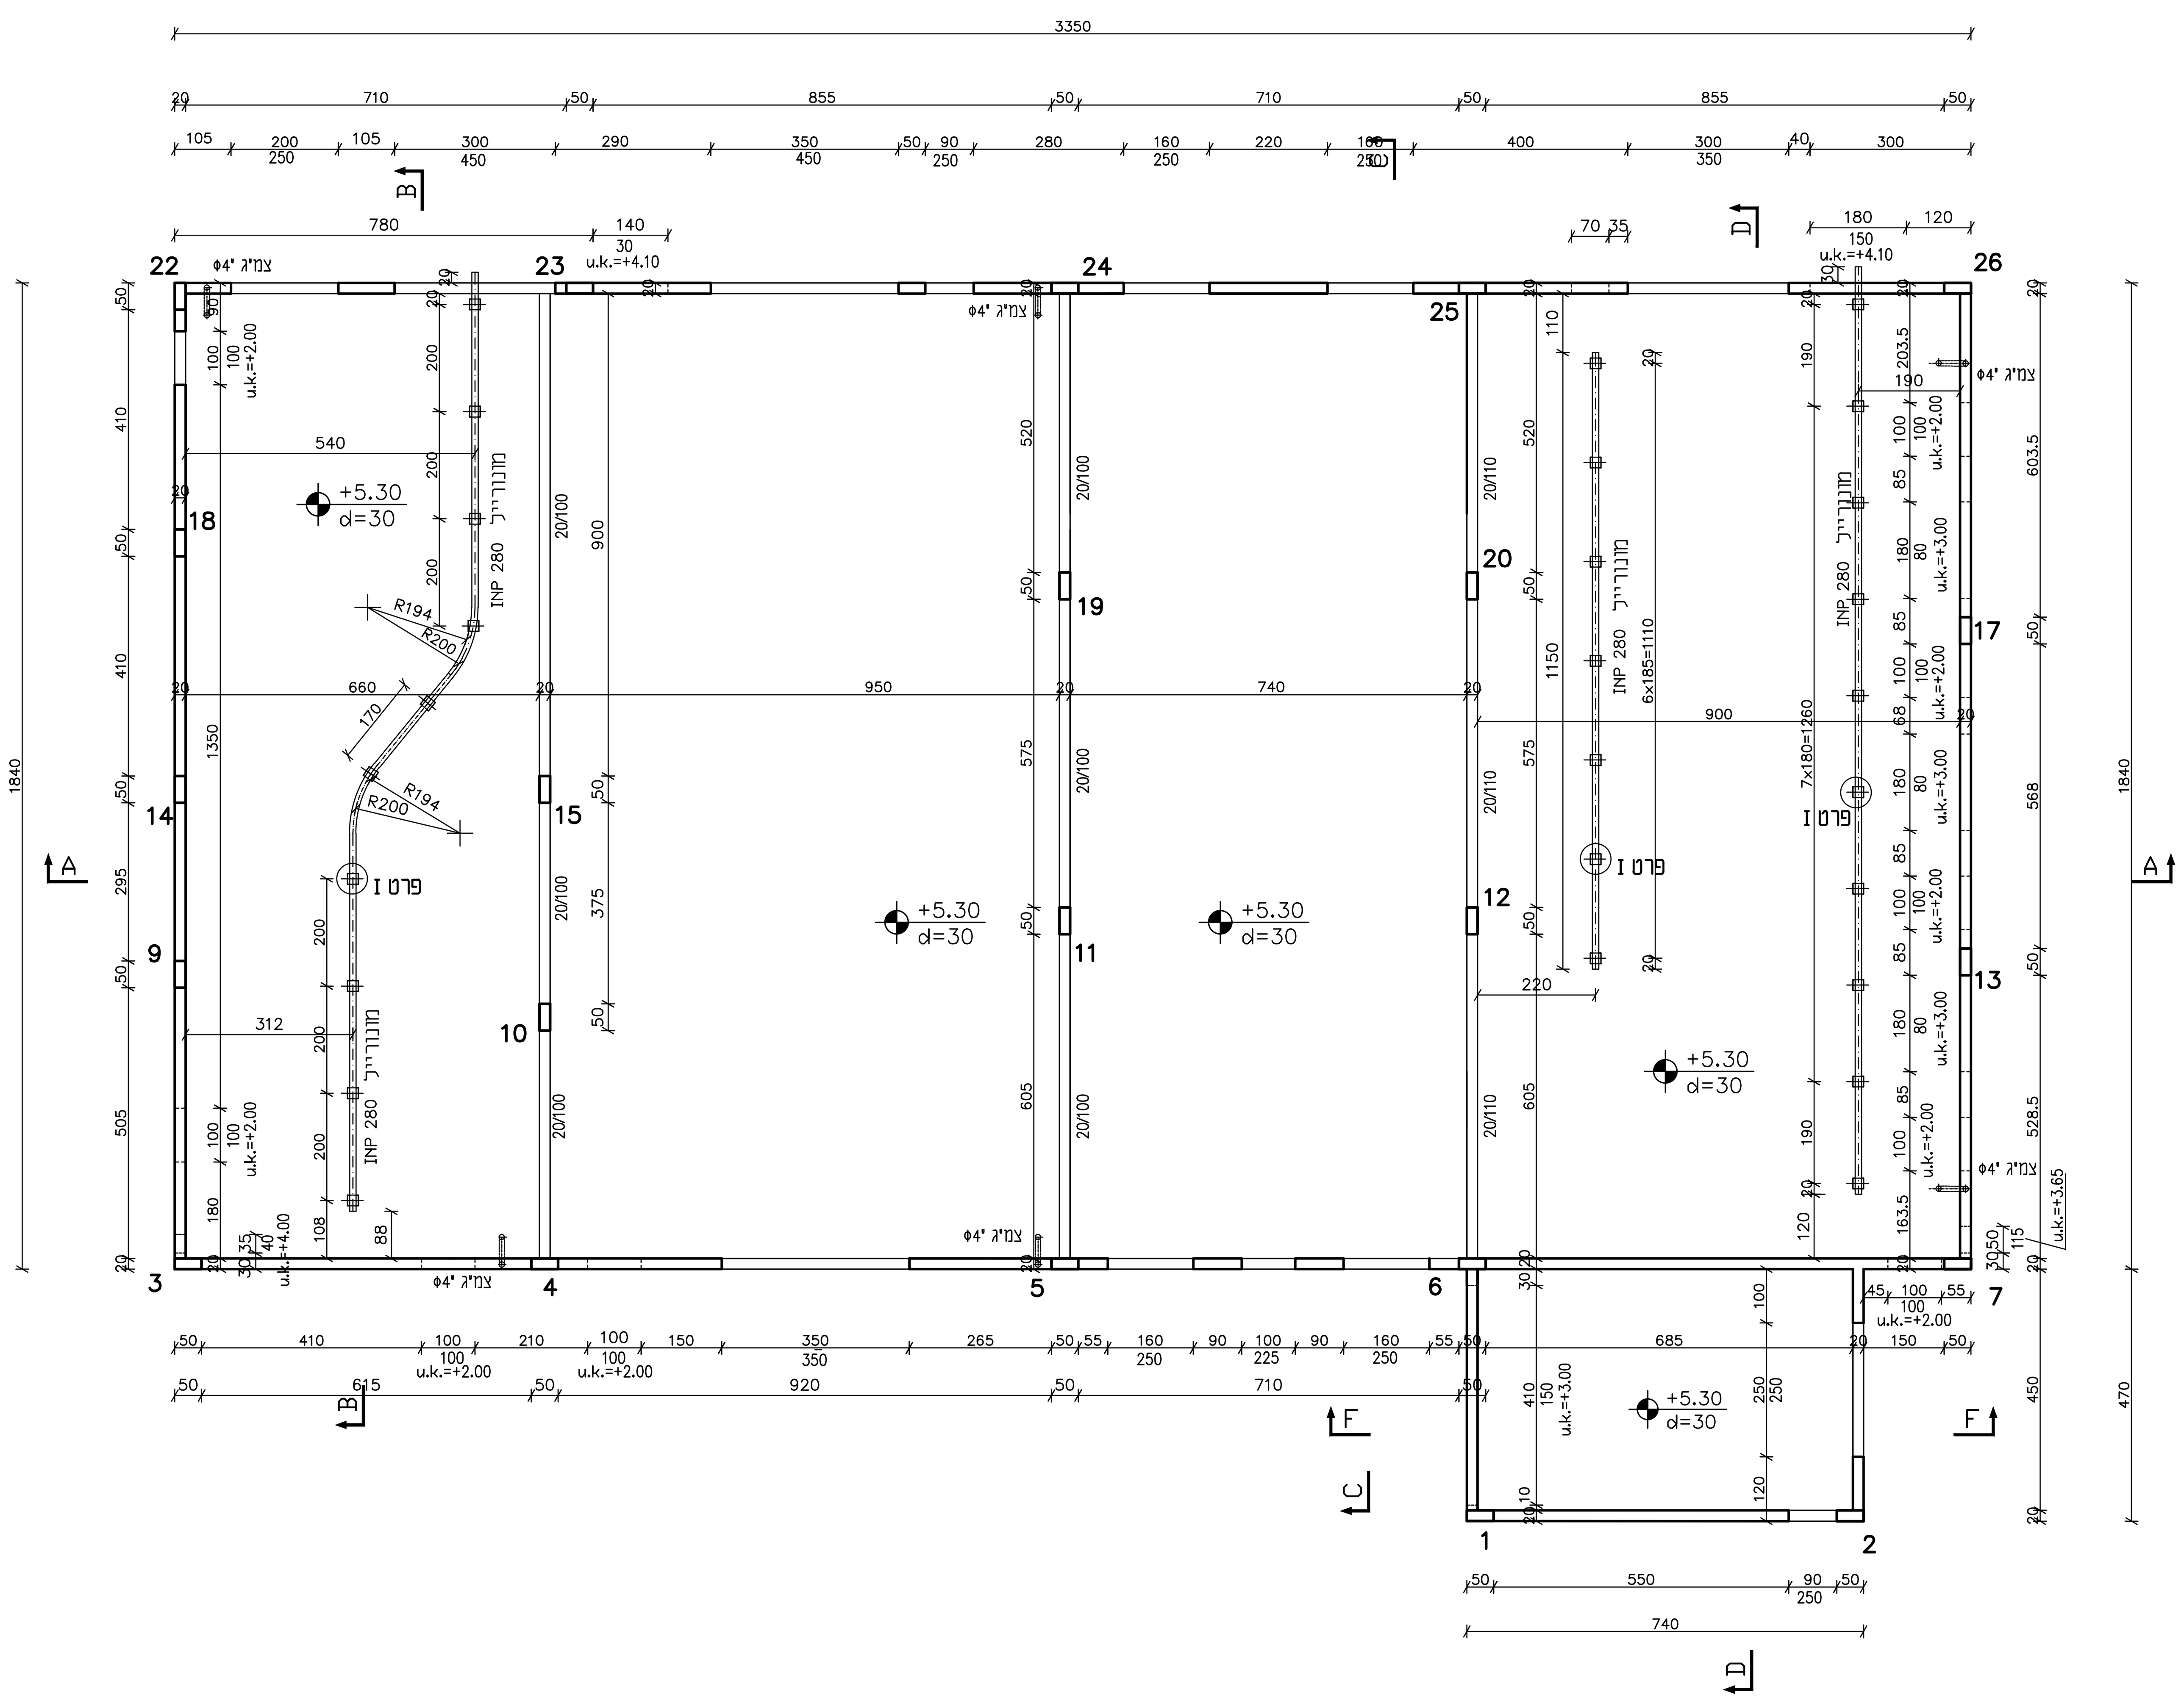

חתך II - II
1 : 10
כל המידות במ"מ

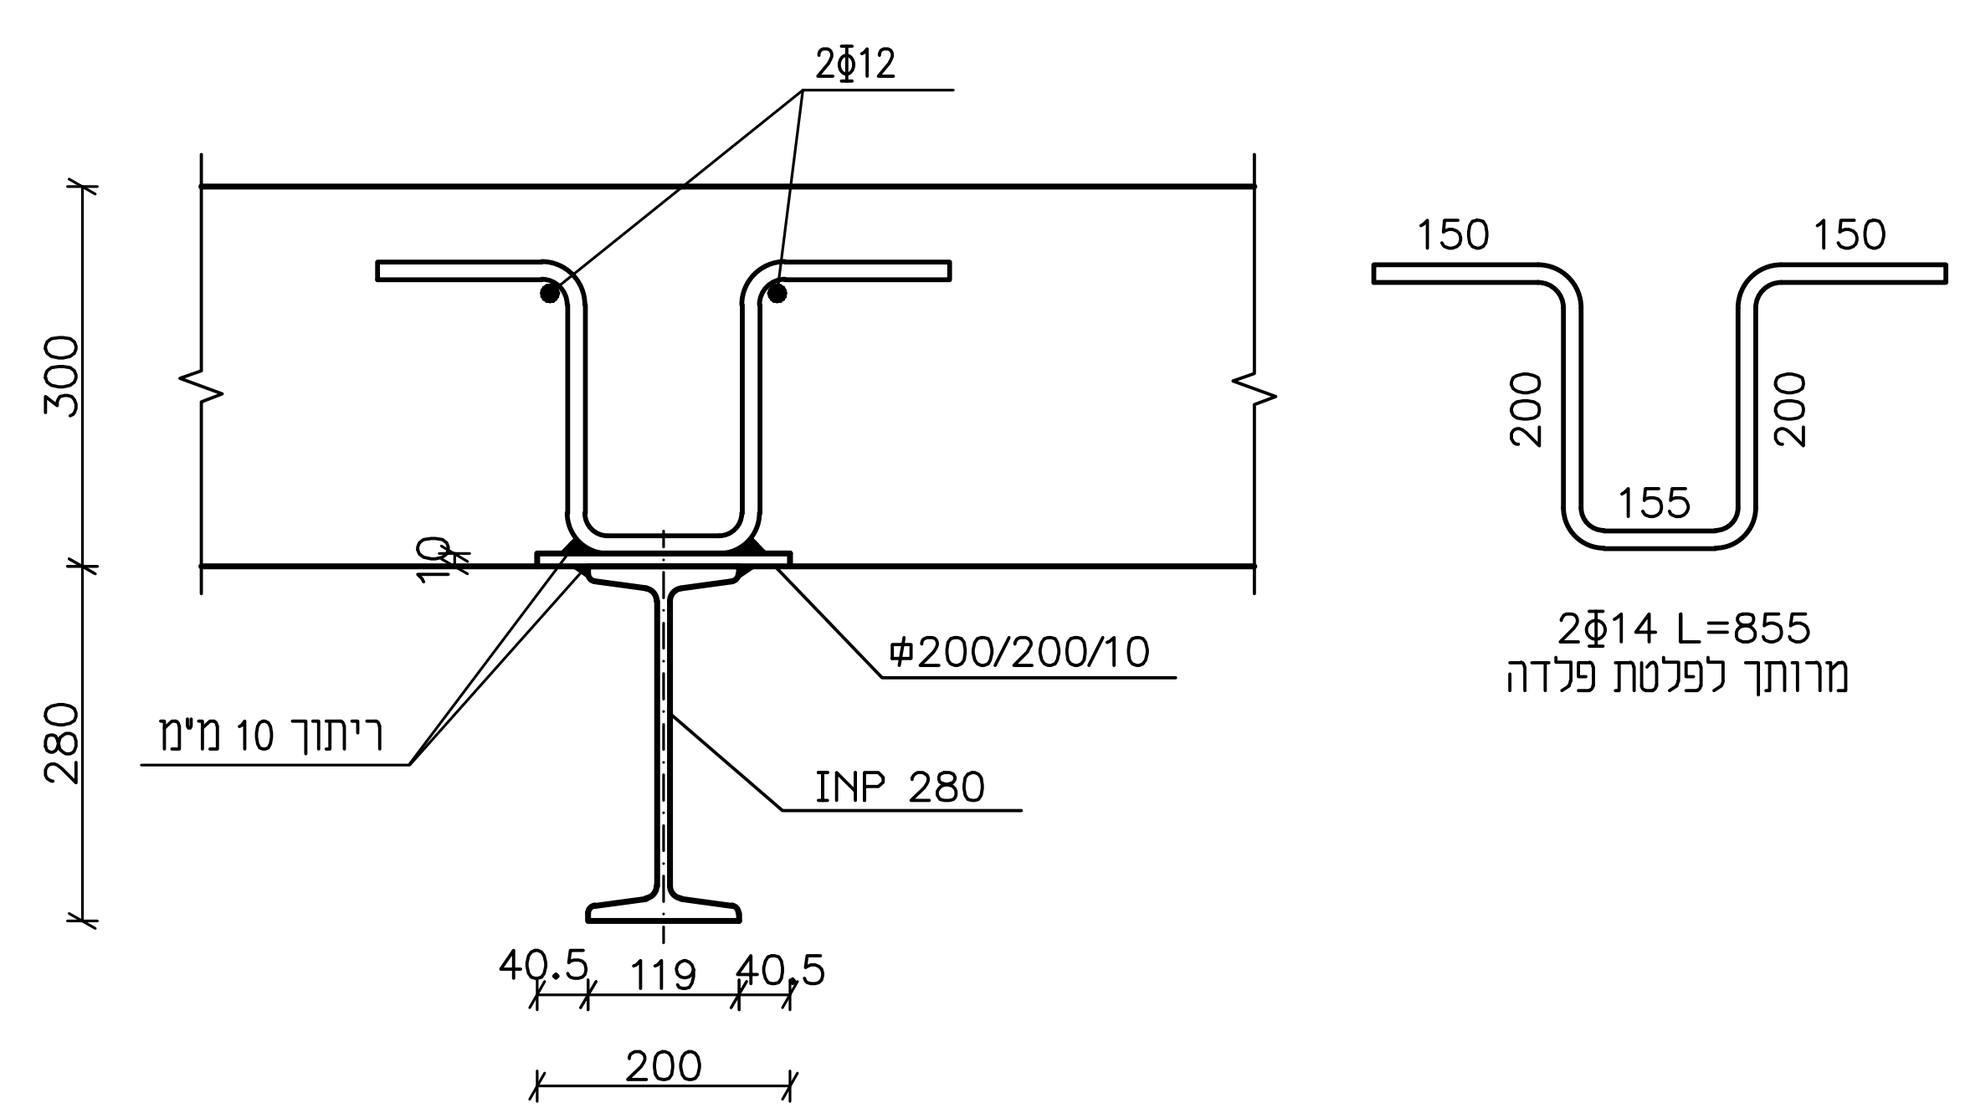

פרט I
1 : 10
כל המידות במ"מ

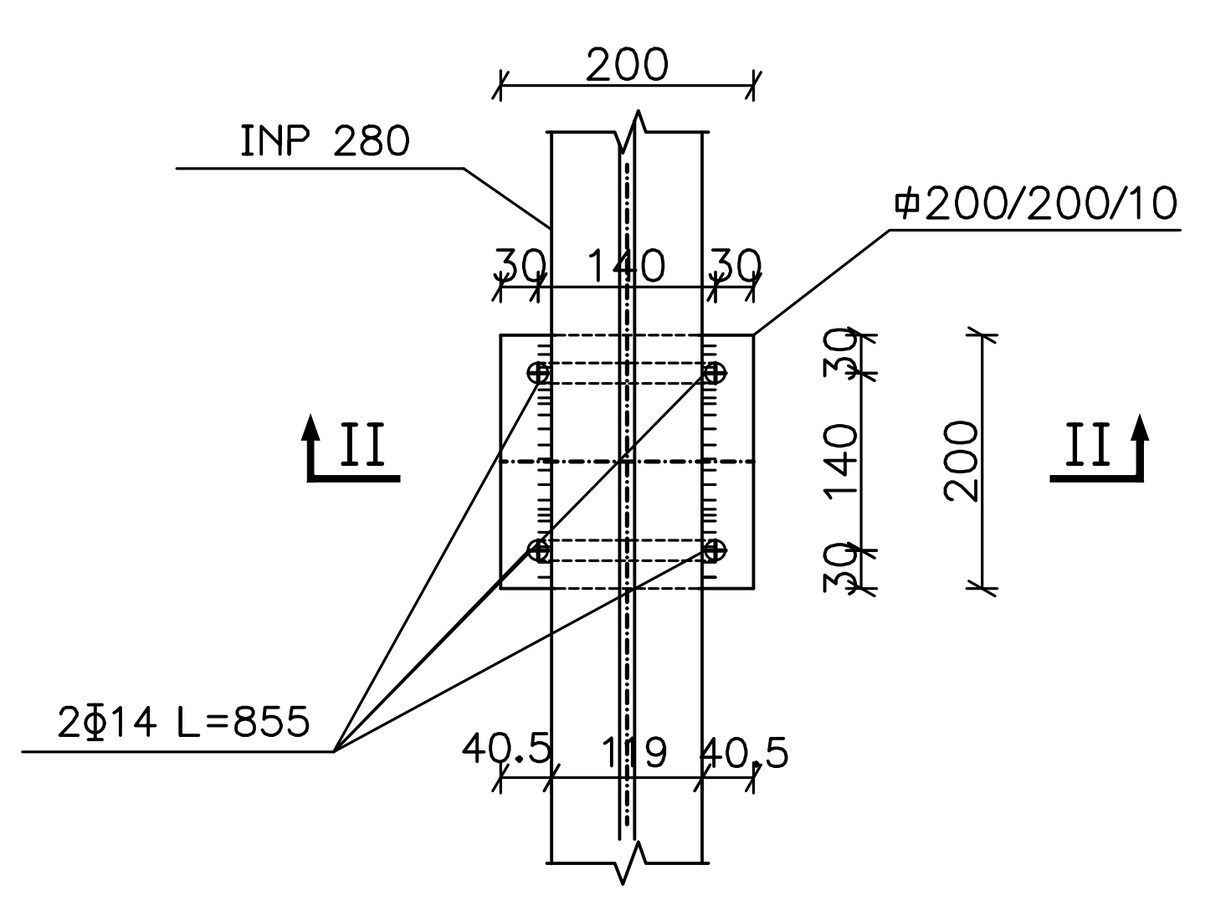

דוד שחם – הנדסת מבנים
רח' החרושת 7 רמת-השרון 47279
טל' 03-5479122 , פקס' 03-5472792
E-MAIL: shahm505@netvision.net.il

מס'	תאריך	תכנן	שרטט	בקר	אשר	תיאור השינויים
0	27.07.21	דוד	עמוס	דוד	דוד	למכרז
P1	29.07.20	דוד	עמוס	דוד	דוד	לעיון ולאישור
P0	15.06.20	ד.ש.	ע.נ.	ד.ש.	ד.ש.	לעיון ולאישור

לעיון ○ למכרז ● לביצוע ○ מהדורה/שינוי 0

פרויקט: **מט"ש קרית שמונה**

לקוח: מי התנור – זורמים עד אליך

שם התכנית:
מבנה טיפול בבוצה
חשמל ומפוחים
תכנית הגג

DHVMED
ENVIRONMENT.CONSULTING.ENGINEERING
רח' גד מנלה 1 ת.ד. 8058 אזור התעשיה החדש נתניה 42504
www.dhvmed.com 09-8853901 פקס. 09-8852312 טל.

levels in : measures in: cm scale :1:100 1:10	drawing size A1	project number 1135

file number	drawing number
1135-35-09-001	1135-35-09-004

© DHV MED Ltd. This drawing may not be reproduced and or made public by print, photocopy, microfilm or any other means, without the prior written permission of DHV MED Ltd., and it may be not be used without such permission for any work other than the one for which it was made

100 mm.